

Test laboratory for the fire behavior of building materials
Testing, supervising and certifying body, authorized by the building supervision authority

TEST REPORT PZ-Hoch-260209

for the proof of Fire behaviour according to DIN 4102, part 1

Translation of the German test report – no guarantee for translation of technical terms

company	INDETEX nv/sa Rue du Mont Gallois 58 B-7700 Mouscron
description of samples	fabric consisting of Polyester FR, with acrylic coating on one side colour 1: light beige / white colour 2: beige / white
name of the material	„CORVO”
sampling	by the company itself
content of request	Proof of flammability to classify building materials to class B1 “schwerentflammbar” according to DIN 4102, part 1
validity of test report	31.01.2031
result	The examined product meets light beige / white and beige / white the requirements of class B1 for “schwerentflammbare” (hardly flammable) building materials according to DIN 4102, part 1 (May 1998) , suspended freely or with distance of >40 mm to same or other plain materials.

This test report includes 5 pages and 8 enclosures.

Remark: If the above mentioned building material is not used as product according to MBO § 2, Abs. 10, there is no need for a general building supervisory test report.

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- “allgemeine bauaufsichtliche Zulassung” (general building inspectorate approval) or by
- „allgemeines bauaufsichtliches Prüfzeugnis“ (general building inspectorate certificate) or by
- “Zustimmung im Einzelfall” (exceptional approval)

This test report can underlie building supervisory procedures

- for regular building products for the prescribed proofs of conformity
- for non regular building products for the needed proofs of applicability.

This test report must not be published and copied without preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents.

1. Description of test material in condition as delivered

PN 43180: “CORVO” colour: light beige / white
-fabric consisting of Polyester FR, with acrylic coating on one side-
side A: light beige / side B: white, coated
characteristic values determined by the test laboratory:
area weight: about 284g/m² thickness: about 0,32mm

PN 43181: “CORVO” colour: beige / white
-fabric consisting of Polyester FR, with acrylic coating on one side-
side A: beige / side B: white, coated
characteristic values determined by the test laboratory:
area weight: about 286g/m² thickness: about 0,31mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

2. Preparation of samples

The samples were kept in climate chamber 23/50 until they reached constant weight.

3. Arrangement of samples mounting: freely suspended

#1252	flaming side A in warp direction	light beige / white
#1253	flaming side B in warp direction	light beige / white
#1254	flaming side A in weft direction	light beige / white
#1257	flaming side A in weft direction	beige / white
#1333	flaming side A in weft direction	beige / white
#1334	flaming side B in weft direction	beige / white

4. Date of test CW 02 and 05 in 2026

5. Results The test has been examined according to DIN 4102 (Mai 1998)

line no.	Measurement	Result with the tested specimen						Dim.
	Test number	#1252	#1253	#1254	#1257	#1333	#1334	
	flamed direction	warp	warp	weft	weft	weft	weft	
	flamed side	A	B	A	A	A	A	
	colour of fabric	light beige / white			beige / white			
1	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	1	1	1	1	1	1	
2	Maximum flame height above bottom edge of the specimen	40	50	50	70	80	80	cm
3	Time ¹⁾	0:06	0:05	0:07	0:08	0:10	0:09	min:s
4	Burn through / melting Time ¹⁾	0:09	0:09	0:08	0:10	0:06	0:08	min:s
5	Observations on the back side of the specimen Flames / Glowing Time ¹⁾	---	---	---	---	---	---	min:s
6	Change of color Time ¹⁾	./.	./.	./.	./.	./.	./.	min:s
7	Falling of burning droplets Start ¹⁾	./.	./.	./.	./.	./.	./.	min:s
8	Extent							
9	sporatic falling of burning droplets ²⁾	---	---	---	---	---	---	min:s
10	continuous falling of burning droplets ²⁾	---	---	---	---	---	---	min:s
11	Falling of burning droplets Start ¹⁾	./.	./.	./.	./.	./.	./.	min:s
12	Extent							
13	sporatic falling of burning droplets ²⁾	---	---	---	---	---	---	min:s
14	continuous falling of burning droplets ²⁾	---	---	---	---	---	---	min:s
15	Afterflame time at the bottom of the sieve (max.)	./.	./.	./.	./.	./.	./.	min:s
16	Impairment of the burner by dropping or falling material: Time ¹⁾	./.	./.	./.	./.	./.	./.	min:s
17	Final occurrence of burning at the specimen ¹⁾	0:45	0:50	0:45	1:00	0:30	0:45	min:s
18	Time of eventually end of test ¹⁾	./.	./.	./.	./.	./.	./.	min:s
19	Afterflame after end of test Time ¹⁾	./.	./.	./.	./.	./.	./.	min:s
20	Number of specimen	./.	./.	./.	./.	./.	./.	
21	Front side of specimen ²⁾	./.	./.	./.	./.	./.	./.	
22	Back side of specimen ²⁾	./.	./.	./.	./.	./.	./.	
23	flame length	./.	./.	./.	./.	./.	./.	cm

line no.	Measurement	Result with the tested specimen						Dim.
	Test number	#1252	#1253	#1254	#1257	#1333	#1334	
	flamed direction	warp	warp	weft	weft	weft	weft	
	flamed side	A	B	A	A	A	A	
22	<u>Afterglow after end of test</u> Time ¹⁾	./.	./.	./.	./.	./.	./.	min:s
23	Number of specimen	./.	./.	./.	./.	./.	./.	
	<u>Place of appearance</u>	./.	./.	./.	./.	./.	./.	
24	Lower half of the specimen ²⁾	./.	./.	./.	./.	./.	./.	
25	Upper half of the specimen ²⁾	./.	./.	./.	./.	./.	./.	
26	Front side of specimen ²⁾	./.	./.	./.	./.	./.	./.	
27	Back side of specimen ²⁾	./.	./.	./.	./.	./.	./.	
28	<u>Density of smoke</u> ≤ 400 % * min	19	9	18	17	19	23	% * min
29	> 400 % * min ⁴⁾	./.	./.	./.	./.	./.	./.	
30	Diagram: encl. no.	1	2	3	4	5	6	
31	<u>Residual lengths:</u> individual value ³⁾							
	Specimen 1	49	51	48	40	34	36	cm
	Specimen 2	48	50	39	35	35	36	cm
	Specimen 3	49	59	45	45	33	39	cm
	Specimen 4	47	54	50	40	37	37	cm
32	<u>Average value, individual test</u> ³⁾	48	54	46	40	35	37	
33	<u>Photo of specimen in enclosure no.</u>	1	2	3	4	5	6	
34	<u>Flue gas temperature</u>	105	113	113	106	125	126	°C
35	Maximum of average value Time ¹⁾	09:36	09:51	09:54	09:57	0:12	09:57	min:s
36	Diagram: encl. no.	1	2	3	4	5	6	
37	Remarks: - none -							

¹⁾ indication of times: from the begin of testing procedure

²⁾ checked off if applicable

³⁾ indication of carrier/foam layer separated in case of fire-proofing agents

⁴⁾ very strong development of smoke

6. Explanations concerning the testing procedure

-none-

7. Summary of results and additional establishments to Fire Behaviour

line	measurement	Result with the tested specimen						dime nsio
		#1252	#1253	#1254	#1257	#1333	#1334	
	flamed direction	warp	warp	weft	weft	weft	weft	
	flamed side	A	B	A	A	A	A	
	colour of fabric	light beige / white			beige / white			
1	residual length	48	54	46	40	35	37	cm
2	max. smoke temperature	105	113	113	106	125	126	°C
3	density of smoke - integral	19	9	18	17	19	23	%min
4	remarks: none							

According to DIN 4102, part 1, "schwerentflammbare" (hardly flammable) building materials must meet the requirements of class B2.

Pursuant to additional tests in the ignitability apparatus this can be determined (appendix 7 & 8).

8. Special remarks


- This report is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or grounds etc. the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid, as soon as the fabric is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, im particular private proprietary rights.
- For legal interests only the German original version is relevant.
- In General Building Inspectorates procedures this test report can be based for
 - regular building materials for the required proof of accordance
 - for not regular building materials for the required proof of applicability

9. Validity


This test report is valid until the mentioned date on page 1. The test report becomes invalid in case the standards on which the tests are based are changed.

Fladungen, 18.02.2026

clerk in charge:

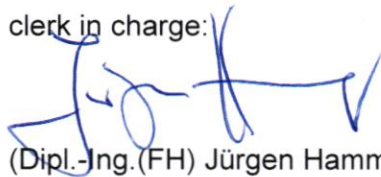

(Dipl.-Ing.(FH) Jürgen Hammer)




Head of the test laboratory:



(Dipl.-Ing.(FH) Andreas Hoch)

----- End of report -----

„Brandschacht“-test #1252

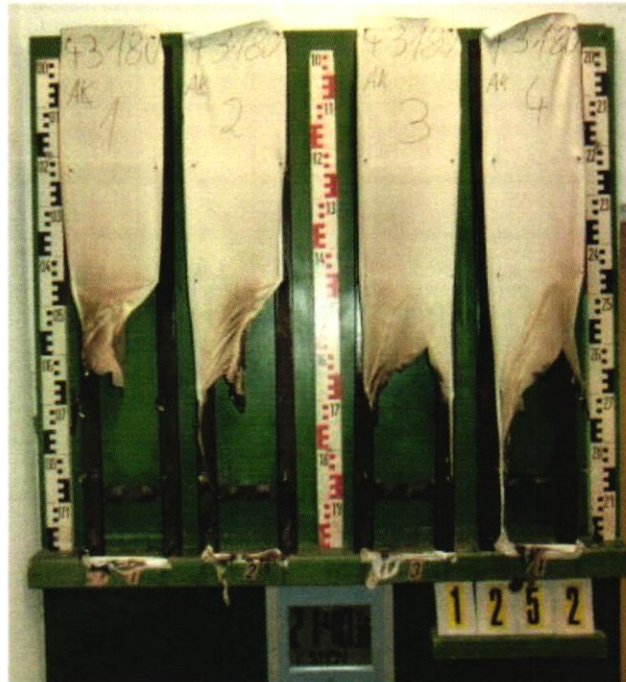


measurement


#1252, PN43180: A+K

Max. flue temperature: 105°C, Smoke density integral: 19%min

Residual length: 48 cm

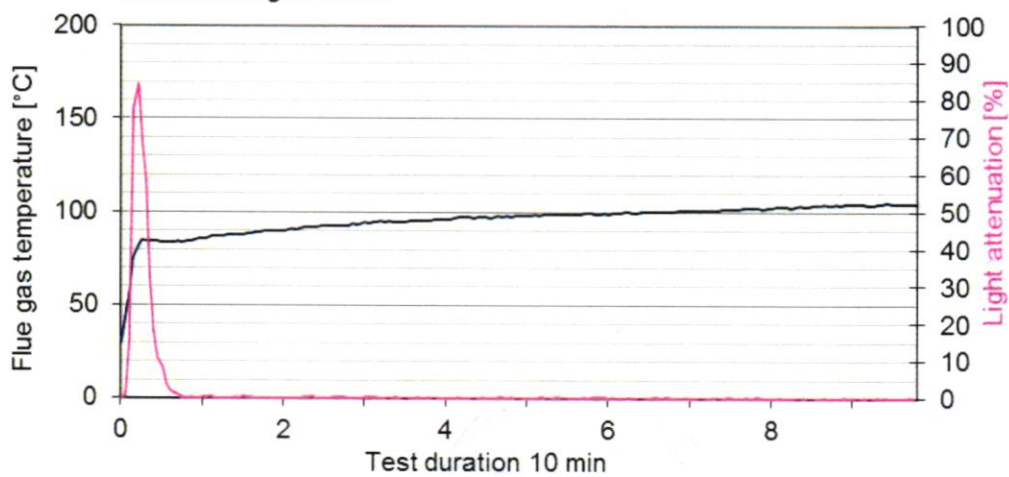

„Brandschacht“-test #1253

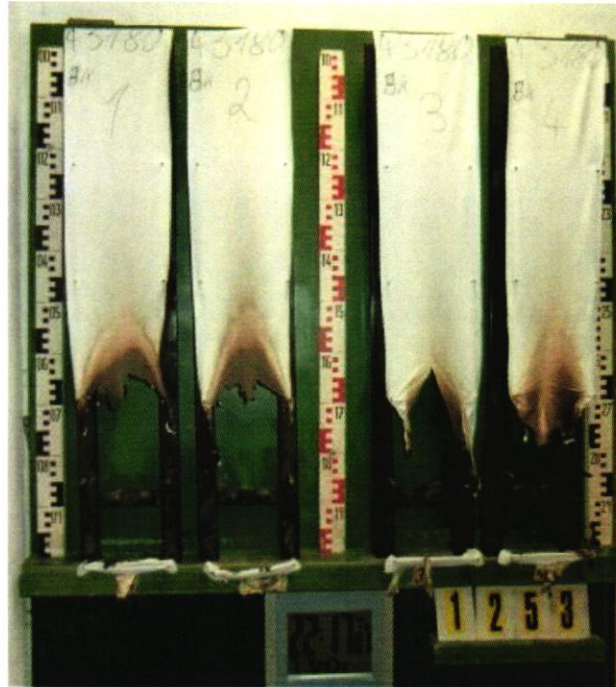


measurement


#1253, PN43180: B+K

Max. flue temperature: 113°C, Smoke density integral: 9%min

Residual length: 54 cm

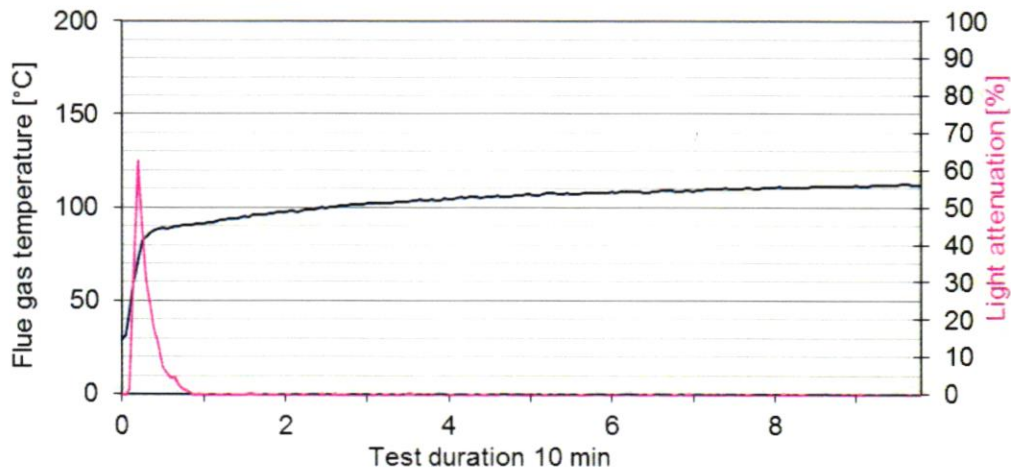

„Brandschacht“-test #1254

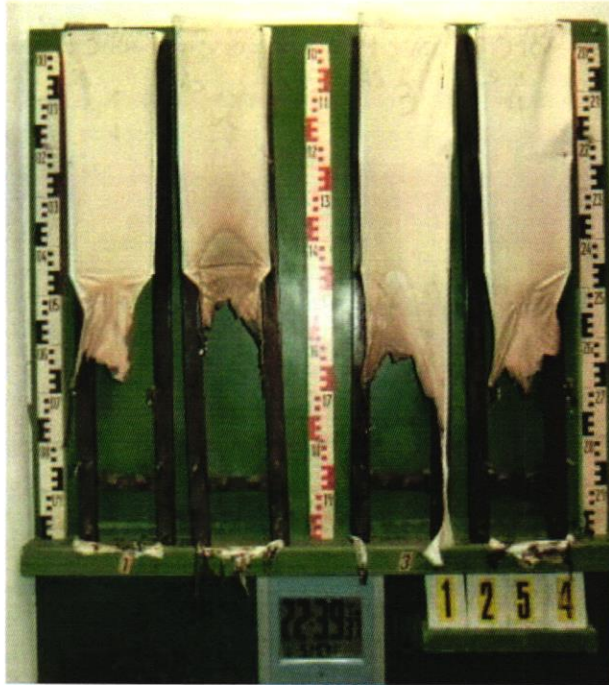


measurement


#1254, PN43180: A+S

Max. flue temperature: 113°C, Smoke density integral: 18%min

Residual length: 46 cm

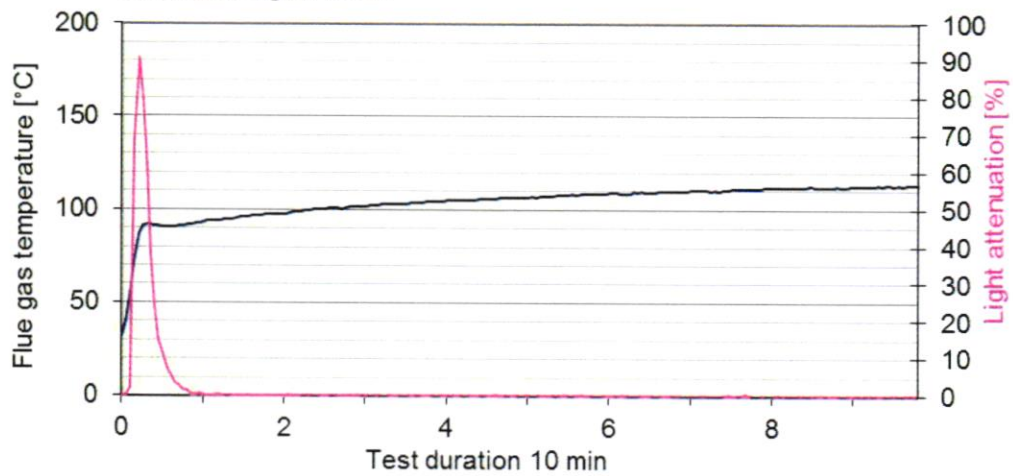

„Brandschacht“-test #1257

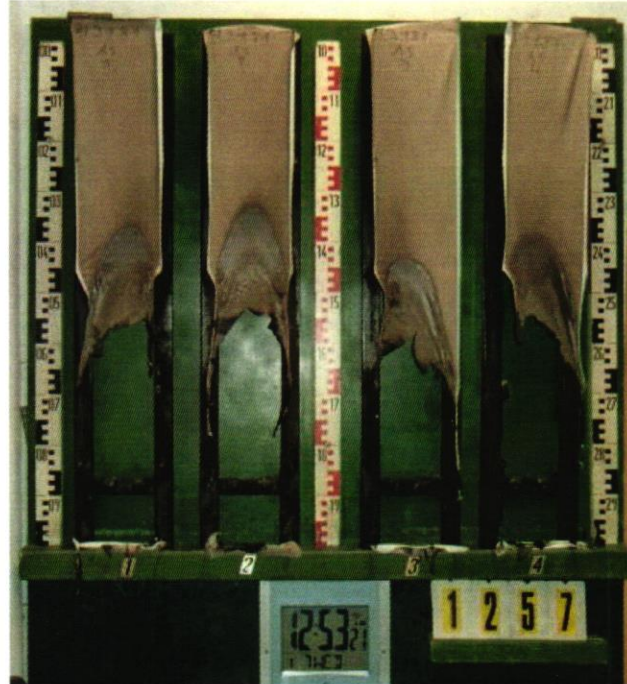


measurement


#1257, PN43181: A + S

Max. flue temperature: 106°C, Smoke density integral: 17%min

Residual length: 40 cm

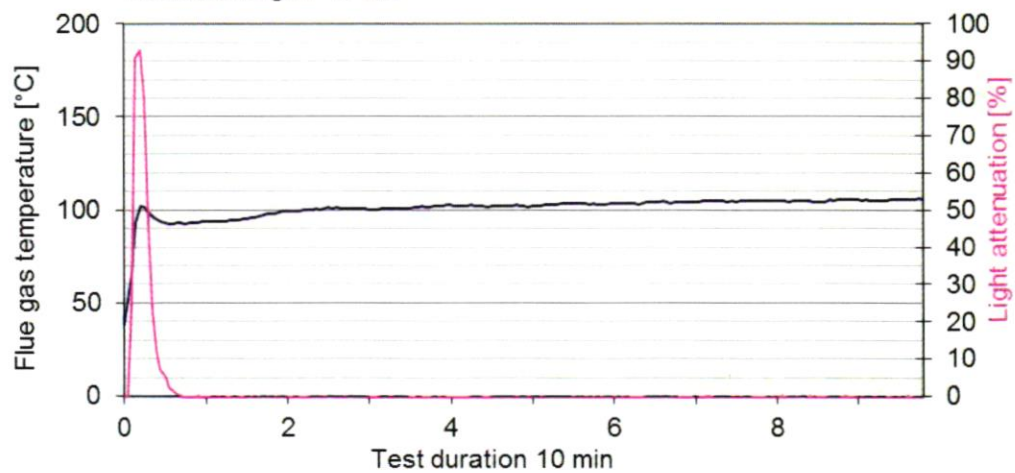

„Brandschacht“-test #1333

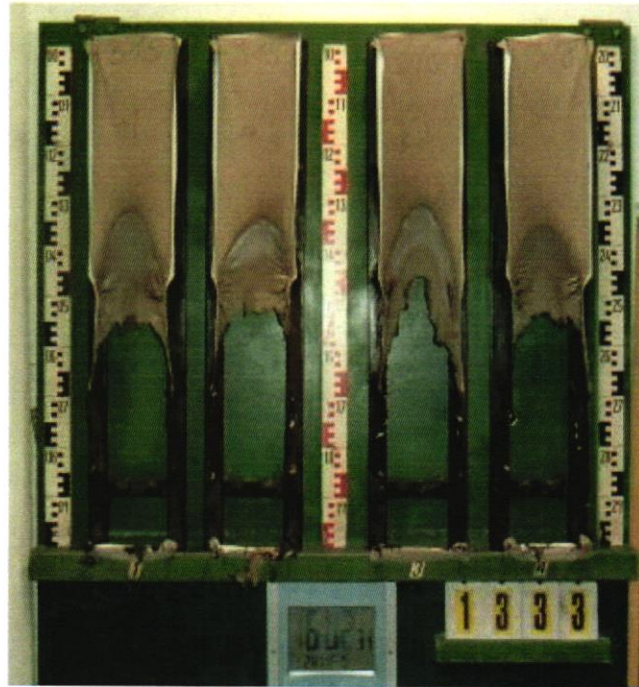


measurement


#1333, PN43181: A + S

Max. flue temperature: 125°C, Smoke density integral: 19%min

Residual length: 35 cm

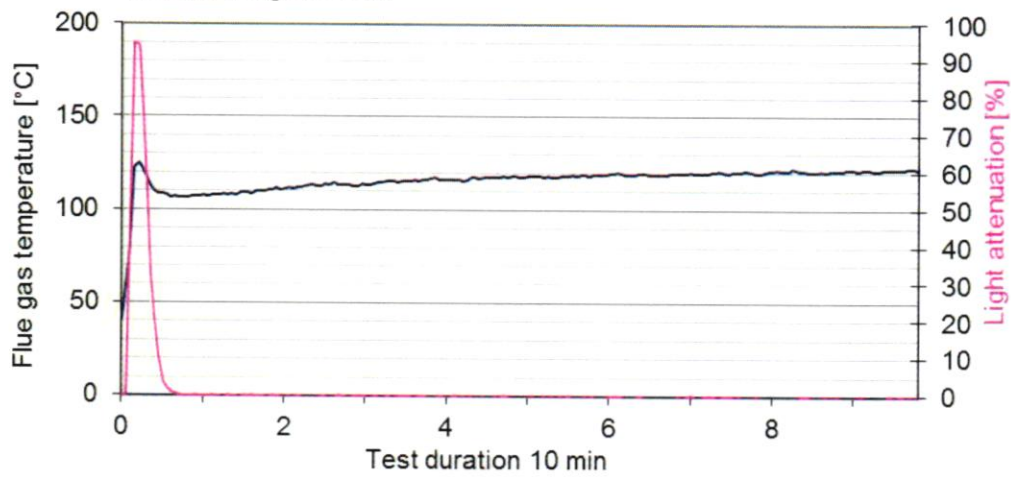

„Brandschacht“-test #1334

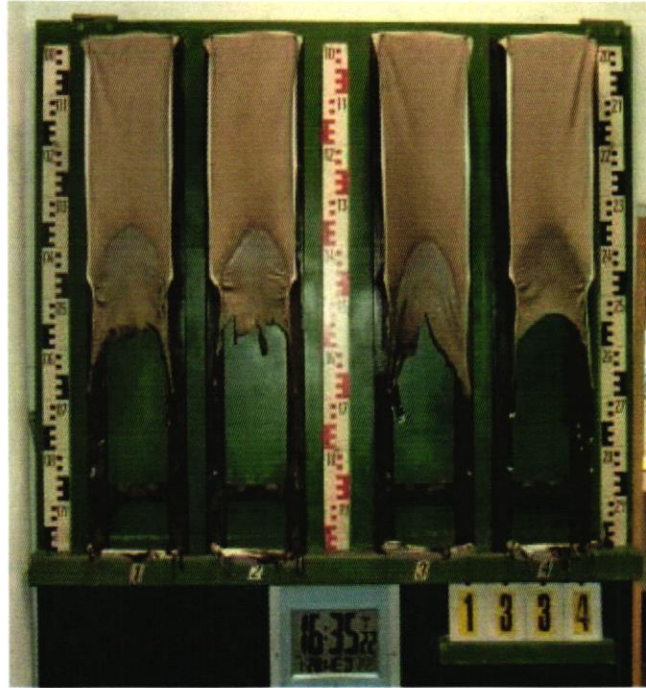


measurement

#1334, PN43181: A + S

Max. flue temperature: 126°C, Smoke density integral: 23%min

Residual length: 37 cm

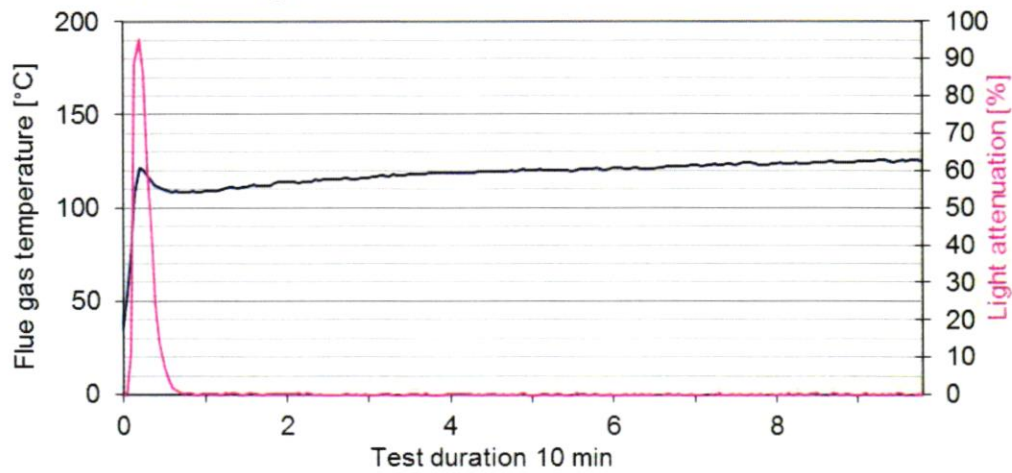

**Test for normal flammability
classifying B2 according to DIN 4102**

1. Description of test material in condition as delivered look at page 2
2. Preparation of samples
 Out of the material there have been cut samples for the ignitability apparatus.
 The samples were kept in a climate 23/50 until they reached constant weight.
3. Arrangement of samples -freely suspended-
 Flaming in warp and weft direction / side A and side B
4. Date of test CW 51 in 2025
5. Results

PN 43180: side B in warp direction	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
ignition ¹⁾	1	1	1	1	1	--	5	--	--	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	-/-	-/-	-/-	-/-	-/-	--	./.	--	--	--	--	--	s
max. flame height	11	10	10	9	10	--	8	--	--	--	--	--	cm
time	7	6	7	8	9	--	15	--	--	--	--	--	
self cessation of the flames end of afterflame ¹⁾	8	7	9	9	9	--	16	--	--	--	--	--	s
end of glowing ¹⁾	19	22	21	21	20	--	23	--	--	--	--	--	s
flames were extinguished after ¹⁾	-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	
smoke development (visual)	very heavy						very heavy						
dropping of burning material during 20 s ¹⁾	-/-	-/-	-/-	-/-	-/-	--	-/-	--	--	--	--	--	s
Appearance after test: burned out till max. height 10 cm x width 3 cm													

PN 43180: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	
arrangement of samples side / direction	A/K	A/S	B/S	--	--	--	A/K	A/S	B/S	--	--	--	
ignition ¹⁾	1	1	1	--	--	--	4	5	5	--	--	--	s
reaching the mark of measurement ¹⁾²⁾	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
max. flame height	7	10	5	--	--	--	11	10	11	--	--	--	cm
time	8	5	6	--	--	--	15	10	15	--	--	--	
self cessation of the flames end of afterflame ¹⁾	10	8	7	--	--	--	18	15	16	--	--	--	s
end of glowing ¹⁾	20	21	20	--	--	--	22	21	21	--	--	--	s
flames were extinguished after ¹⁾	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
smoke development (visual)	very heavy						very heavy						
dropping of burning material during 20 s ¹⁾	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
Appearance after test: burned out till max. height 10cm x width 3cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/- no appearance -- no information
K: warp / S: weft

PN 43181: additional tests	edge-test						surface-test						Dim
	1	2	3	4	5	6	1	2	3	4	5	6	
samples no.													
arrangement of samples side / direction	A/K	B/K	A/S	B/S	--	--	A/K	B/K	A/S	B/S	--	--	
ignition ¹⁾	1	1	1	1	--	--	5	5	5	5	--	--	s
reaching the mark of measurement ¹⁾²⁾	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
max. flame height	5	6	10	10	--	--	9	7	9	7	--	--	cm
time	4	7	5	10	--	--	10	10	14	10	--	--	
self cessation of the flames end of afterflame ¹⁾	5	10	6	11	--	--	15	15	15	15	--	--	s
end of glowing ¹⁾	20	21	16	19	--	--	20	19	20	23	--	--	s
flames were extinguished after ¹⁾	-/-	-/-	-/-	-/-	--	--	-/-	-/-	-/-	-/-	--	--	s
smoke development (visual)	very heavy						very heavy						
dropping of burning material during 20 s ¹⁾	-/-	-/-	-/-	--	--	--	-/-	-/-	-/-	--	--	--	s
Appearance after test: burned out till max. height 9cm x width 3cm													

¹⁾ time mentioned from the beginning of the test ²⁾ during 20 Sec -/- no appearance -- no information
 K: warp / S: weft

6. Remarks and explanations to the testing procedure - none –

7. Opinion concerning the dropping of burning material

The test for normal flammability shows no burning dripping material.

----- End of enclosures -----